


NON-POTABLE TAP DIAGRAM

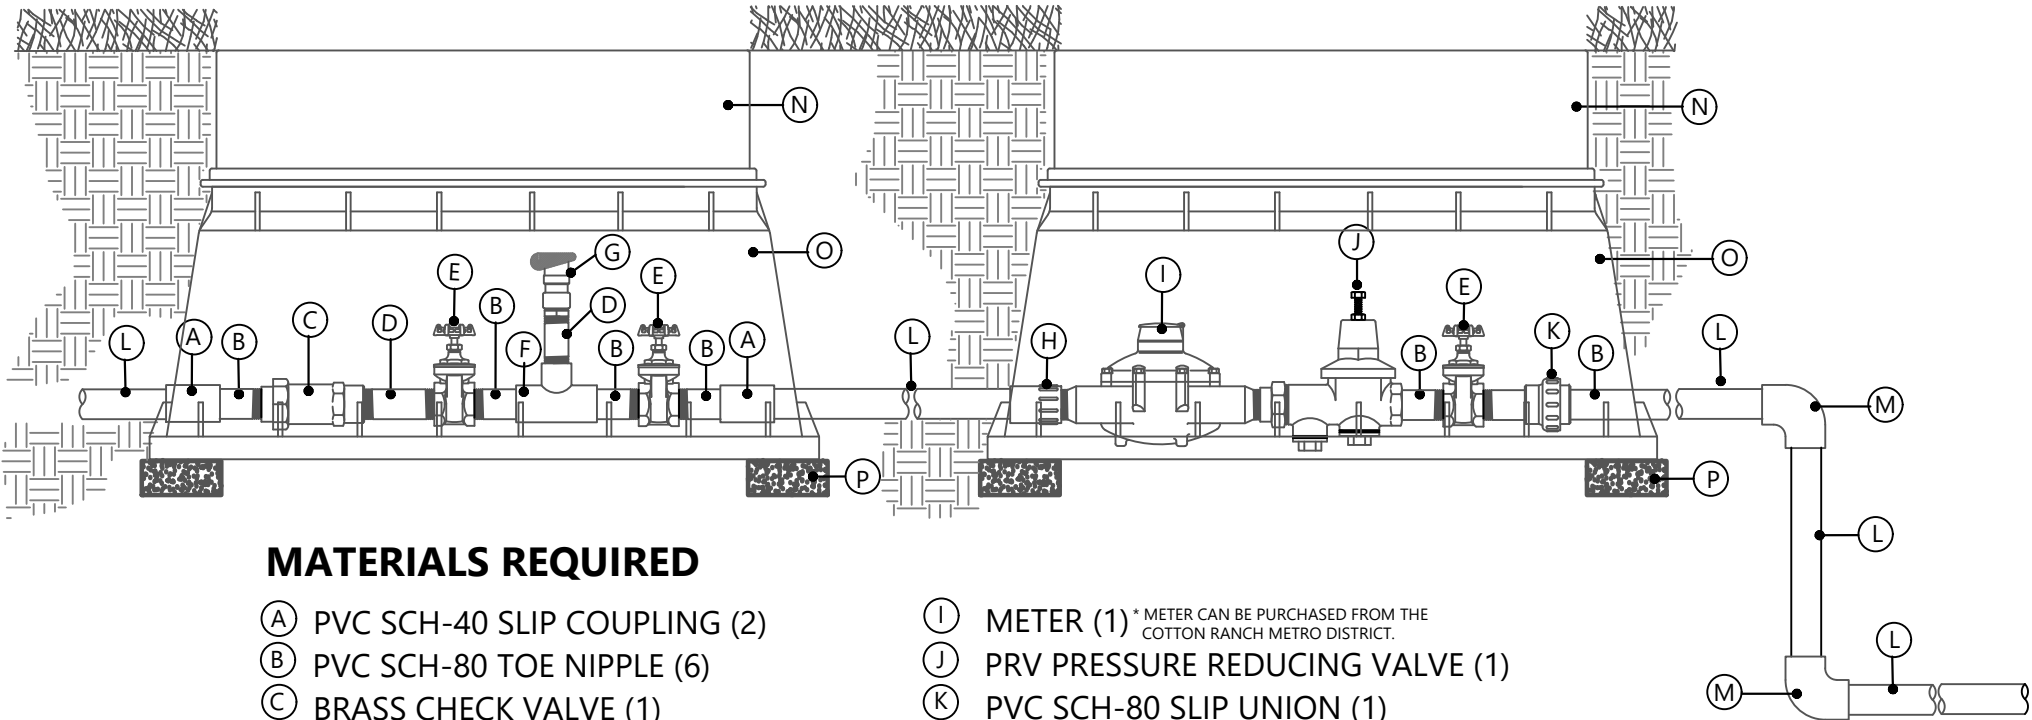

MATERIALS REQUIRED

- | | |
|--|--|
| <ul style="list-style-type: none"> (A) PVC SCH-40 SLIP COUPLING (2) (B) PVC SCH-80 TOE NIPPLE (6) (C) BRASS CHECK VALVE (1) (D) PVC SCH-80 THREADED NIPPLE (1) (E) BRASS GATE VALVE (3) (F) PVC SCH-40 SLIP X FIPT COMBO TEE (1) (G) QUICK COUPLER VALVE (1) (H) PVC SCH-40 FEMALE ADAPTER (1) | <ul style="list-style-type: none"> (I) METER (1) * METER CAN BE PURCHASED FROM THE COTTON RANCH METRO DISTRICT. (J) PRV PRESSURE REDUCING VALVE (1) (K) PVC SCH-80 SLIP UNION (1) (L) PVC SCH-40 PIPE (LENGTH AS NEEDED) (M) PVC SCH-40 90° SLIP ELBOW (2) (N) JUMBO VALVE BOX OR LARGER AS NEEDED (2) (O) JUMBO VALVE BOX EXTENSION OR LARGER AS NEEDED (2) (P) 4X4 BRICK FOR VALVE BOX SUPPORT (8 TO 12 AS NEEDED) |
|--|--|